
RTD

Power supply: erupply: ly: tion

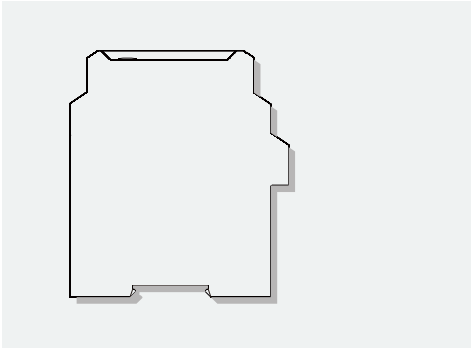

National Supervision and Inspection Center for Explosion Protection and Safety of Instrumentation (NEPSI)

Ex marking: [Ex ia Ga] ⅡC
[Ex ia Da] C

Um: 250V

Certified parameters (Terminals 1, 2, 3; 4, 5, 6):

Uo=8.7V, Io=33mA, Po=72mW

ⅡC: Co=5μF, Lo=28mH

C(ⅡB): Co=49μF, Lo=84mH